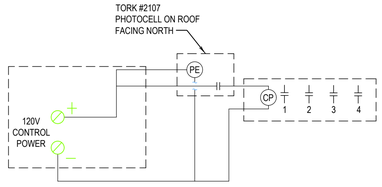


## TIME CLOCKS 12

NOT TO SCALE E-400

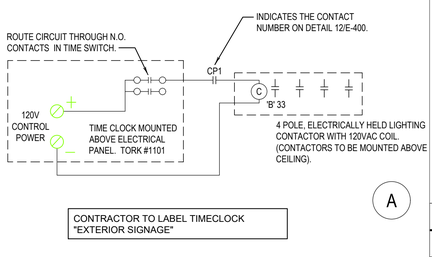


CONTRACTOR TO LABEL TIMECLOCK
"EXTERIOR SIGNAGE"

A

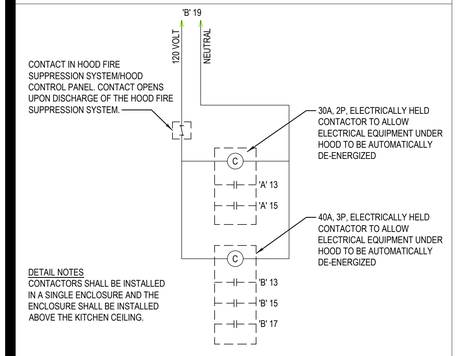


## FIRE SUPPRESSION SHUTDOWN 13

NOT TO SCALE E-400

NOT USED
"DRIVE THROUGH AND EXTERIOR SIGNAGE"

B

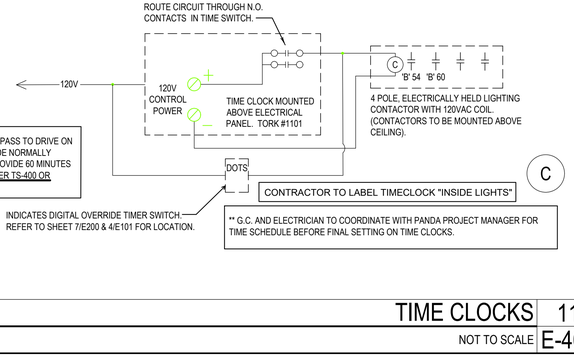


DIGITAL OVERRIDE TIMER SWITCH: SHALL BE INSTALLED AS A BYPASS TO DRIVE ON THE INTERIOR LIGHTING WHEN OPERATION IS REQUIRED OUTSIDE NORMALLY PROGRAMMED HOURS. OVERRIDE SWITCH SHALL BE SET TO PROVIDE 60 MINUTES OF EXTENDED OPERATING TIME. SWITCH SHALL BE WATTSTOPPER TS-400 OR EQUIVALENT.

CONTRACTOR TO LABEL TIMECLOCK "INSIDE LIGHTS"

C

** G.C. AND ELECTRICIAN TO COORDINATE WITH PANDA PROJECT MANAGER FOR TIME SCHEDULE BEFORE FINAL SETTING ON TIME CLOCKS.

## TIME CLOCKS 11

NOT TO SCALE E-400




## FREEZER LTG & DOOR HTR WIRING DIAGRAM 10

NOT TO SCALE E-400

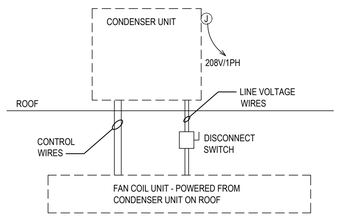


## FREEZER EVAPORATOR COIL 9

NOT TO SCALE E-400




## CONDENSING UNIT 7

NOT TO SCALE E-400

1. WIRING SHOULD BE DONE ACCORDING WITH NATIONAL AND LOCAL CODE.

2. CHECK VOLTAGE ON CONDENSING UNIT AND EVAPORATOR COIL BEFORE ANY WORK IS DONE.

3. SOLID LINES TO BE WIRED BY LICENSED ELECTRICIAN ON SITE. DOTTED LINES ARE MANUFACTURE PRE-WIRED.

4. ANY PENETRATIONS THROUGH BOX SHALL BE SEALED AIR TIGHT.

## WIC / WIF WIRING DIAGRAM NOTES 6

NOT TO SCALE E-400

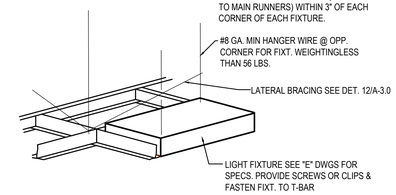


## LIGHT FIXTURE DETAIL 4

NOT TO SCALE E-400

### DEVICE ORIENTATION

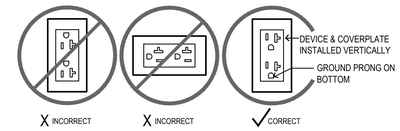


### DEVICE & COVERPLATE COLOR

| LOCATION | DEVICE COLOR | COVER PLATE COLOR | NOTES |
|---|---|---|---|
| DINING ROOM (WALLS) | VERIFY W/PX | VERIFY W/PX | VERIFY WITH PANDA PM PRIOR TO PURCHASE AND INSTALL |
| DINING ROOM (IN BULKHEAD ABOVE WINDOWS) | VERIFY W/PX | VERIFY W/PX | VERIFY WITH PANDA PM PRIOR TO PURCHASE AND INSTALL |
| DINING ROOM (WHEN IN CEILING) | BLACK | BLACK | @ SHOW WINDOW IN DARK CEILING (IF APPLICABLE) |
| RESTROOM | GREY | STAINLESS STEEL | -- |
| RESTROOM VESTIBULE | GREY | STAINLESS STEEL | -- |
| KITCHEN/SERVICE AREAS | GREY | STAINLESS STEEL | -- |

## RECEPT. DIAGRAM 3

NOT TO SCALE E-400

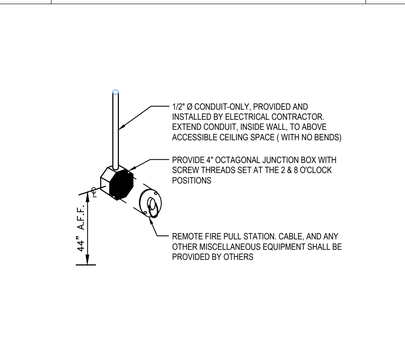


## ANSUL PULL STATION DETAIL 2

NOT TO SCALE E-400

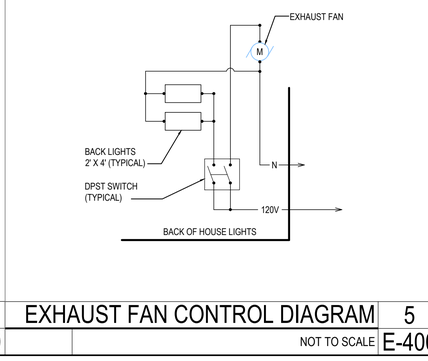


## COOLER EVAPORATOR COIL 8

NOT TO SCALE E-400




## EXHAUST FAN CONTROL DIAGRAM 5

NOT TO SCALE E-400

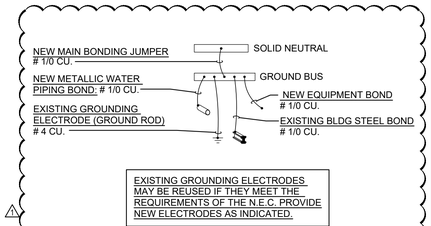


EXISTING GROUNDING ELECTRODES MAY BE REUSED IF THEY MEET THE REQUIREMENTS OF THE N.E.C. PROVIDE NEW ELECTRODES AS INDICATED.

## GROUNDING DETAIL 1

NOT TO SCALE E-400


PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288



All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.


REVISIONS:

| | | |
|---|---|---|
| 1 | PERMIT RESPONSE 1 | 06-01-2020 |

ISSUE DATE:

| | |
|---|---|
| PEER REVIEW | 01-27-2020 |
| PR RESPONSE 1 | 02-21-2020 |
| BUILDING PERMIT | 03-11-2020 |

DRAWN BY: G. COLLINS

PANDA PROJECT #: D7446

ARCH PROJECT #: JCDT19-0314


NORR
ARCHITECTS ENGINEERS PLANNERS


PANDA EXPRESS

GREENBRIAR TOWN CENTER,
13059 LEE JACKSON MEMORIAL HWY
FAIRFAX, VA 22033

# E-400

ELECTRICAL DETAILS, DIAGRAMS